



UPS-XBDM-20RHW

Bypass Distribution Module

User & Installation Manual

Table of Contents

Introduction.....6

ProductDescription.....6

 Bypass Distribution Description.....6

System Configuration.....7

 LED Description.....8

Hardware Installation Guide.....9

 Installation.....9

Wiring and Connecting.....10

 Initial Connection.....10

 Startup Sequence.....10

User’s Operations.....11

 Normal Operation.....11

 Bypass Operation.....11

Specifications.....12

Obtaining Service.....13

Limited Warranty.....14

Thank you for selecting the UPS-XBDM-20RHW bypass distribution module. It is designed to work in conjunction with a UPS to provide protection for connected equipment. **Please read this manual** before installing the UPS-XBDM-20RHW as it provides important information that should be followed during installation to allow you to correctly set up your system for maximum safety and performance. Included is information on customer support and service. If you experience a problem with the XBDM, please contact technical support.

WARNING: Incorrect installation, operation, and/or modifications made to the XBDM will void the manufacturer's warranty. Lowell Manufacturing Company is not liable for personnel or equipment damages as a result.

IMPORTANT SAFETY INSTRUCTIONS: (SAVE THESE INSTRUCTIONS)

CAUTION! Two sources of power are present in the XBDM: UPS power and Utility power.

CAUTION! (UPS has Internal Batteries): Risk of electrical shock – Hazardous live parts inside the UPS are energized from the battery supply even when the input AC power is disconnected.

CAUTION! (No User serviceable Parts): Risk of electrical shock, do not remove cover. No user serviceable parts inside. Refer servicing to qualified service personnel.

WARNING! Unit intended for installation in a controlled environment per installation instructions.

CAUTION! If flammable substances such as gases or fumes are present, or if the room is airtight, a hazardous situation may exist in which no electrical equipment should be operated.



WARNING!

It is strongly recommended that the XBDM not be opened as components have very high voltage and touching those components may be fatal. Only a qualified technician or authorized agent may service the unit.

The XBDM unit's output receptacles can carry live voltage even when not connected to an input voltage source. The UPS has its own internal energy source.



CAUTION!

The unit has a dangerous amount of voltage. If either the UPS or BYPASS indicator is on, the unit's outlets may have a dangerous amount of voltage even when not plugged into the wall outlet because the battery from the UPS may continue to supply power.

For indoor use in temperature and humidity-controlled environments only.

Not for use where explosive and/or electrically conductive airborne contaminants or dust are present (including but not limited to coal dust, metal grinding dust, grain processing dust, etc.).

It is best to disconnect the device using the power supply cord. Ensure that the equipment is placed in a position near the outlet where easily accessible.

All servicing on this equipment must be carried out by qualified service personnel.

The Bypass Distribution Module (XBDM) is intended to allow replacement of the UPS connected without having to shut down the equipment connected to the load circuits on the XBDM. Caution should be observed as the XBDM is always supplied with power by either the UPS or UTILITY.

Environment

Ensure that all environmental concerns and requirements are met according to specifications listed in this document, otherwise the safety of installation personnel cannot be guaranteed, and the unit may malfunction.

Ensure that you remember the following when locating the XBDM:

- Avoid extremes of temperature and humidity.
 - » Operating temperature: 0°C to +50°C (+32° to +122° F)
 - » Operating elevation: 0 to 3000m (0-10,000 ft)
 - » Relative humidity: 0-90%, non-condensing
 - » Storage temperature: 0-65° C (+32 to +149° F)
 - » Storage elevation: 0 to 15,000m (0 to +50,000 ft)
- Provide protection for the equipment from moisture.
- Space and ventilation requirements must be met.

Introduction

The information provided in this manual covers single phase hardwired 20A bypass distribution module, its basic functions, operating procedures, options available and emergency situations. It also includes information on how to ship, store, handle, and install the equipment. Only detailed requirements of the XBDM unit are described herein, and installation must be carried out in accordance with this manual. Refer to the associated UPS manual for UPS operating instructions. Electrical installation must also carefully follow local legislation and regulations. Only qualified personnel should conduct these installations as failure to acknowledge electrical hazards could prove to be fatal.

Product Description

Many different kinds of sensitive electrical equipment can be protected by an Uninterruptible Power Supply (UPS) including computers, workstations, process control systems, telecommunications systems, sales terminals, other critical instrumentation, etc. The purpose of the XBDM is to provide an extra level of protection in allowing for the replacement of a UPS without powering down the loads connected. The XBDM can work with most single phase topologies. It will not work with topologies that have a phase shift between input and output (like ferro of UPS with an isolation transformer).

Electrical interference exists in many forms, causing problems in AC power, from lightning, power company accidents and radio transmission motors, air conditioners, and vending machines. Protection of sensitive electrical equipment is vital to protect against power outages, low or high voltage conditions, slow voltage fluctuations, frequency variations, differential and common-mode noise, transients, etc.

To prevent power line problems from reaching critical systems causing damage to software, hardware, and equipment malfunctions, a UPS maintains constant voltage, isolating critical load output and cleaning the utility AC power. When the UPS fails or needs maintenance, many times it is necessary to turn off the UPS and disconnect it from incoming electrical circuits. With the XBDM installed between the incoming Utility and the UPS, you can replace the UPS and/or Batteries without dropping the load. You simply switch the XBDM from UPS power to Utility power and remove the UPS while the load connected to the XBDM continues to operate temporarily from Utility power.


Bypass Distribution Description

The Bypass Distribution Module (XBDM) is designed to operate with a single-phase UPS up to 20Amps in output capacity. The XBDM allows you to:

- Replace or upgrade the UPS without losing power to the protected equipment
- Provide surge protection if the UPS is not present
- Provide extra surge protection when the UPS is present


NORMAL OPERATION shown in the block diagram below:

- Under normal operation, the UTILITY INPUT flows through the XBDM to the UPS and then out to the CONNECTED LOADS.

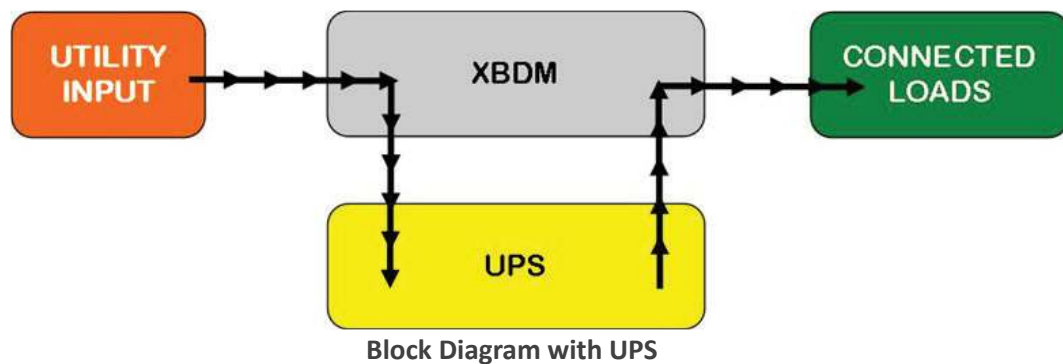


MAINTENANCE OPERATION shown in the block diagram below:

- Under maintenance operation, the UTILITY INPUT flows through the XBDM to the CONNECTED LOADS – the UPS is not in the circuit.

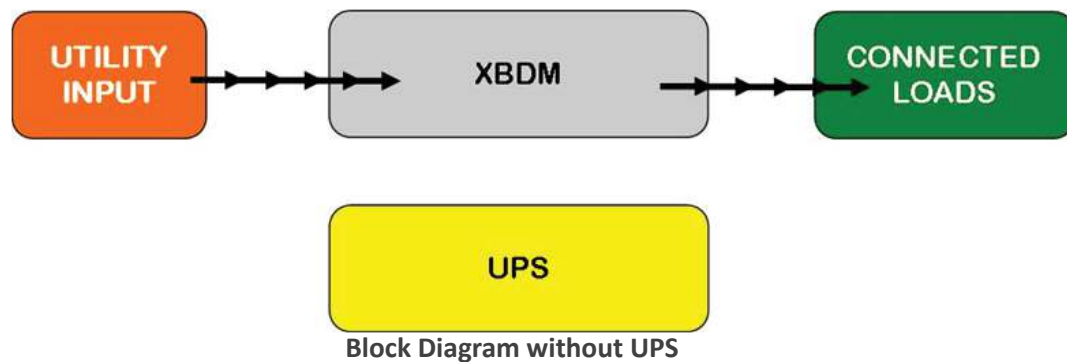

System Configuration

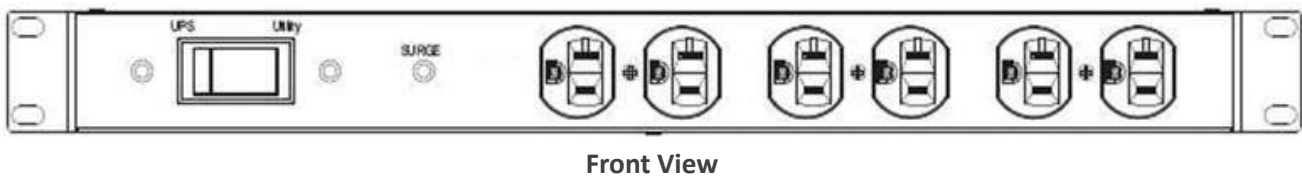


LED Description

The XBDM has three LED's on the front control panel. These LED's allow the user to quickly understand the status of the unit.

Red LED = UPS power is available

Orange LED = Utility is available for Bypass operation


Green LED = Surge Protection is available.

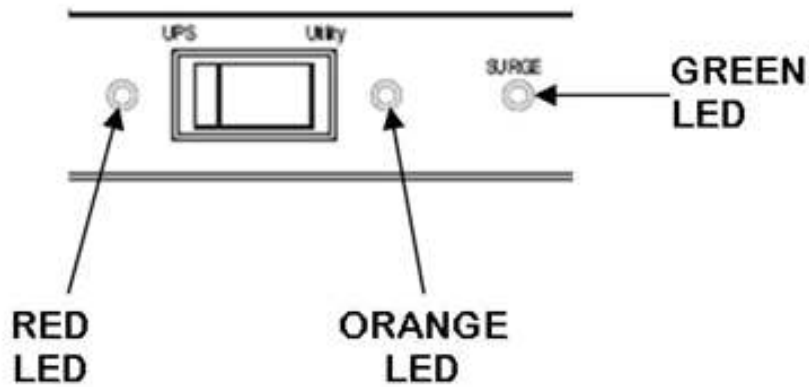

XBDM Front Panel LEDs

CAUTION: The Orange LED must be illuminated before transferring to BYPASS power.

The Red LED must be illuminated before transferring to UPS power.



XBDM Front Panel Bypass Switch

Hardware Installation Guide


Inspect the XBDM upon receipt. The packaging is recyclable; keep it for reuse or dispose of properly.

Installation

The XBDM supports horizontal (1U) rackmount and vertical rackmount installation.

Horizontal Installation (1U)


1. Attach the two (2) XBDM horizontal mounting brackets (included) on each end of the XBDM using four (4) retaining screws (included).

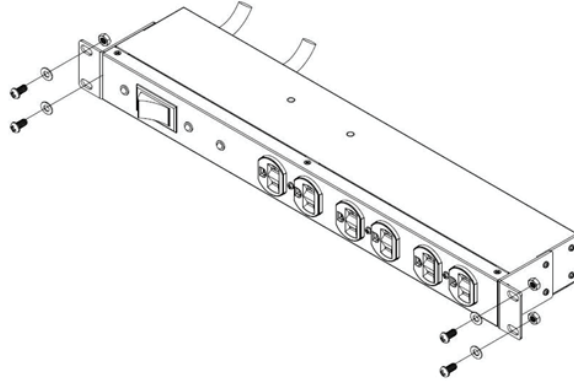

2. Install the XBDM in a suitable horizontal location in the rack rail using four (4) user-provided mounting screws.

Vertical Installation

1. Attach the two (2) XBDM horizontal mounting brackets (included) on each end of the XBDM using four (4) retaining screws (included).

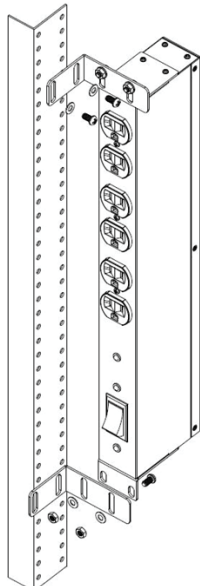


2. Attach the two vertical mounting brackets (included) to the horizontal rack mounting brackets on each end of the XBDM using four (4) retaining screws (included).
3. Install the XBDM in a suitable vertical location on the side of the rack rail with four (4) user provided mounting screws.

Wiring and Connecting


Initial Connection

1. The UPS-XBDM-20RHW is a hardwired input and output Bypass Distribution Module. It must be installed in conjunction with all local electrical codes, with work performed by a licensed electrician.
2. All connections should be completed prior to providing input utility power to the UPS-XBDM-20RHW.
3. Input and Output wiring to the UPS-XBDM-20RHW should be routed through the terminal box knockout. The terminal box cover can be removed for ease of conduit connection and wire routing.

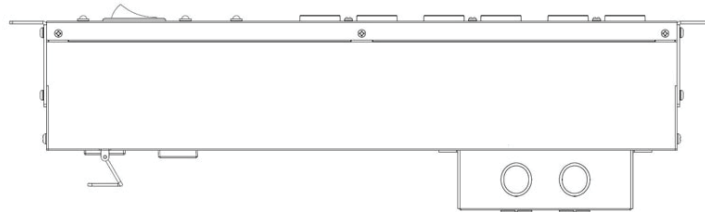

Input and Output Routing

4. Please refer to the drawing below for input and output wiring terminal locations.

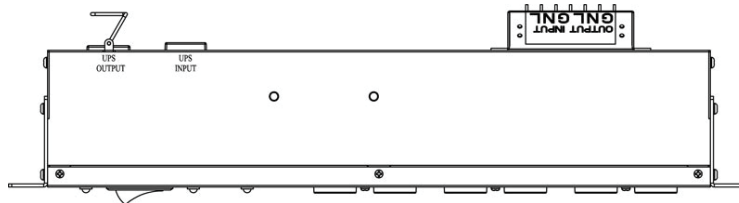

Terminal Block View

Startup Sequence

1. Turn the UPS OFF in accordance with UPS manufacturers' documentation. Verify the correct wiring to the XBDM prior to proceeding to step 2.
2. Unplug the UPS from utility source. Depending on the model of UPS it may take a few seconds for the UPS to completely shut down. All indicators on the UPS front panel should shutdown.
3. Disconnect the protected equipment power cord(s) from the UPS.
4. Verify that the BYPASS switch on the XBDM is in the UPS position.
5. Energize the circuit breaker providing input utility to the UPS-XBDM-20RHW from a properly sized distribution panel.

The orange bypass available light should illuminate on the Bypass Distribution Module.


6. Plug the UPS INPUT cord into the 5-20R receptacle labeled FOR UPS INPUT on the rear of the UPS-XBDM-20RHW.
7. Connect the UPS output receptacle to the UPS-XBDM-20RHW C20 plug labeled UPS OUTPUT using the appropriate 20A cord supplied with the UPS-XBDM-20RHW.
8. Assure that the distribution for the loads to be connected to the UPS-XBDM-20RHW is properly connected to the UPS-XBDM-20RHW.
9. Press the ON BUTTON on the UPS. All indicators on the UPS should operate normally. The red UPS available light should illuminate on the Bypass Distribution Module. Power should now be supplied to the equipment connected to the UPS via the UPS-XBDM-20RHW.

User's Operations

The purpose of this BYPASS DISTRIBUTION MODULE is to allow servicing of the UPS so as not to affect the LOADs connected and protected. To transfer between UPS and utility sources, swiftly actuate the bypass switch to the opposite position. Both the UPS, and Utility lights available must be illuminated to prevent transferring to a non-powered source.

Normal Operation

When operating in NORMAL mode the switch on the front of the XBDM will be in the UPS position



UPS-XBDM-20RHW Bypass Switch – UPS

CAUTION: The red LED on the bypass module must be illuminated before transferring to the UPS position.

Bypass Operation

To transfer your equipment to Maintenance Bypass (AC Line operation) and remove the UPS:

1. Turn the Bypass Switch on the XBDM to BYPASS position. The XBDM is now powering your equipment from Utility power.

CAUTION: The Orange LED must be illuminated before transferring to BYPASS operation.

CAUTION: When the XBDM is operating in UTILITY MODE, the LOAD connected is not protected from power outages.

2. Press the OFF BUTTON on the UPS per the UPS manufacturers' documentation.
3. If any optional Extended Battery Packs or Modules are connected to the UPS, turn off the circuit breaker on the battery pack or module (if applicable), and disconnect the cable from the battery pack or module to the UPS.
4. Disconnect the UPS output cord from the XBDM to the UPS output receptacle.
5. Disconnect the UPS INPUT CORD from the UPS INPUT RECEPTACLE on the XBDM.
6. Remove the UPS.

To reinstall the UPS and transfer your equipment from Maintenance Bypass (AC Line operation) to the UPS:

1. If optional Extended Battery Packs or Modules are installed, reconnect the cable from the battery pack or module to the UPS, and turn on the circuit breaker on the battery back or module (if applicable) per the UPS manufacturers' documentation.
2. Connect the UPS output cord from the XBDM to a UPS output receptacle
3. Plug the UPS INPUT POWER CORD into the XBDM UPS INPUT RECEPTACLE.
4. Start the UPS per the manufactures instructions. The red UPS available light should illuminate on the Bypass Distribution Module.
5. Toggle the Bypass Switch on the XBDM to UPS position. The XBDM is now powering your equipment from UPS power.

Specifications

MODEL NUMBER		UPS-XBDM-20RHW
POWER RATING	Voltage/current	120VAC/20A
INPUT	Utility input	Hardwired terminal block
	Breaker	N/A
OUTPUT	Output	Hardwired terminal block + (6) 5–15R
TRANSFER SWITCH	Capacity	20A break before make rocker switch
	Transfer time	8ms
UPS INPUT	Input connection	5–20R
UPS OUTPUT	Connection to UPS output	3 ft cord with 5–20P plug
AC SURGE	Capacity	6500A, 114J, 330VAC
INDICATORS	LED indicators	Utility, surge, UPS
PHYSICAL	Dimensions (W x D x H)	17 x 3.5 x 1.75 in
	Weight	3.6 lbs
WARRANTY		3 years (2 years outside of USA)
INCLUDED IN BOX		Standard 19" rack mounting hardware

Obtaining Service

If the UPS requires Service:

1. Eliminate obvious causes.
2. Verify there are no circuit breakers tripped.
3. Call your dealer for assistance. If you cannot reach your dealer, or if they cannot resolve the problem, call Lowell Manufacturing Company at 800-325-9660. Please have the following information available BEFORE calling:
 - Your name and address.
 - The serial number of the unit.
 - Where and when the unit was purchased.
 - All of the model information about your UPS.
 - Any information on the failure, including LED's that may or may not be illuminated.
 - A description of the protected equipment, including model numbers if possible.
 - A representative will ask for the above information and, if possible, help solve the problem over the phone. In the event that the unit requires factory service, they will issue a Return Material Authorization number (RMA).

If you are returning the UPS for service, please follow these procedures:

1. Pack the UPS in its original packaging. If the original packaging is no longer available, ask about obtaining a replacement set of packaging material. It is important to pack the UPS properly in order to avoid damage in transit. Never use Styrofoam beads for packing material.
2. Include a letter with your name, address, daytime phone number, RMA number, a copy of your original sales receipt, and a brief description of the problem.
3. Mark the RMA number on the outside of all packages. Lowell cannot accept any package without the RMA number marked on the outside of the boxes.
4. Return the UPS by insured, prepaid carrier to the address provided by the representative.
5. Refer to the Warranty statements in this manual for additional details on what is covered.

Limited Warranty

Lowell Manufacturing Company warrants Lowell Model UPS-XBDM-20RHW equipment, when properly applied and operated within specified conditions, against faulty materials or workmanship for a period of **three years** from the date of purchase. For equipment sites within the United States and Canada, this warranty covers repair or replacement, at the sole discretion of Lowell Manufacturing Company. The customer is responsible for the costs of shipping the defective product to Lowell Manufacturing Company. Lowell Manufacturing Company will pay for ground shipment of the repaired or replacement product. This warranty applies only to the original purchaser.

If equipment provided by Lowell Manufacturing Company is found to be **Dead-on-Arrival (DOA)**, Lowell Manufacturing Company will be responsible for the costs of shipping product to and returning equipment from the customer in a timely manner as agreed to with the customer, once the customer has requested and received a **Return Material Authorization (RMA)** number. DOA equipment is defined as equipment that does not properly function according to user documentation when initially received and connected in conjunction with proper procedures as shown in the user documentation or via support provided by Lowell Manufacturing Company personnel or authorized agents.

This warranty shall be void if (a) the equipment is repaired or modified by anyone other than Lowell Manufacturing Company or a Lowell Manufacturing Company approved third party; (b) the equipment is damaged by the customer, is improperly used or stored, is subjected to an adverse operating environment, or is operated outside the limits of its electrical specifications; or (c) the equipment has been used or stored in a manner contrary to the equipment's operating manual, intended use or other written instructions. Any technical advice furnished by Lowell Manufacturing Company or a Lowell Manufacturing Company authorized representative before or after delivery with regard to the use or application of Lowell Manufacturing Company UPS Series equipment is furnished on the basis that it represents Lowell Manufacturing Company's best judgment under the situation and circumstances, but it is used at the recipient's sole risk.

EXCEPT AS STATED ABOVE, Lowell Manufacturing Company DISCLAIMS ALL WARRANTIES, EXPRESSED OR IMPLIED, INCLUDING WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE.

EXCEPT AS STATED ABOVE, IN NO EVENT WILL Lowell Manufacturing Company BE LIABLE FOR DIRECT, INDIRECT, SPECIAL, INCIDENTAL, OR CONSEQUENTIAL DAMAGES ARISING OUT OF THE USE OF Lowell Manufacturing Company's UPS Series EQUIPMENT, including but not limited to, any costs, lost profits or revenue, loss of equipment, loss of use of equipment, loss of software, loss of data, cost of substitutes, or claims by third parties. Purchaser's sole and exclusive remedy for breach of any warranty, expressed or implied, concerning Lowell Manufacturing Company's UPS Series equipment, and the only obligation of Lowell Manufacturing Company under this warranty, shall be the repair or replacement of defective equipment, components, or parts; or, at Lowell Manufacturing Company's sole discretion, refund of the purchase price or substitution of an equivalent replacement product.