


# UPS mounted with 4-pt. rail kit (side view)

## Minimum depth requirements for Lowell floor racks

### Lowell Floor Rack – 22”D min.


- #UPS9C-1000

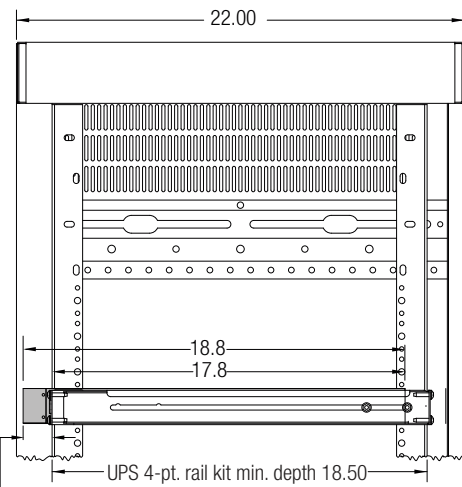

UPS bezel protrudes approx. 1" from rack rail

### Lowell Floor Rack – 22”D min.


- UPS8-1100 or UPS9-1000

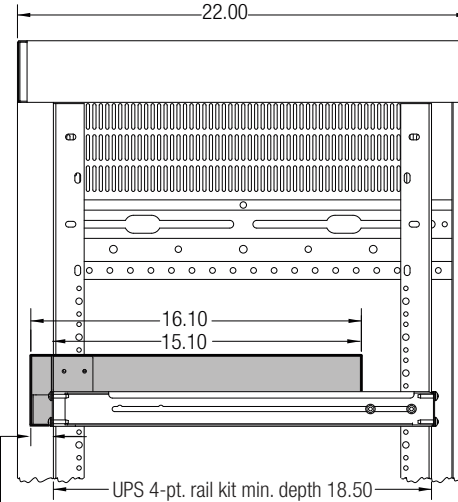

UPS bezel protrudes approx. 1" from rack rail

### Lowell Floor Rack – 27”D min.


- UPS8-1500, UPS8-2000, UPS9-1500, or UPS9-2000

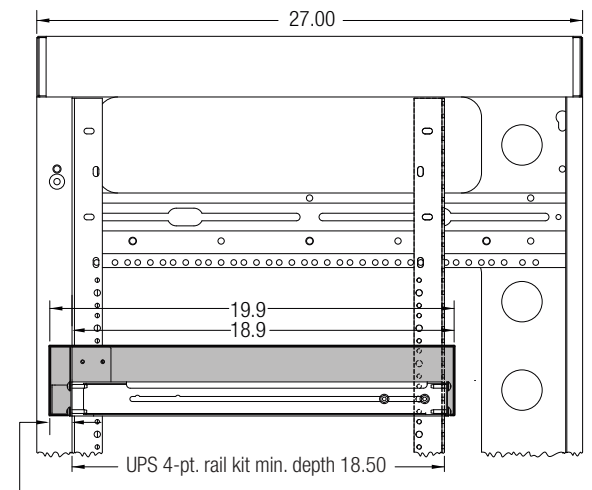

UPS bezel protrudes approx. 1" from rack rail

### Lowell Floor Rack – 32”D min.


- UPS8-2200 or UPS8-3000

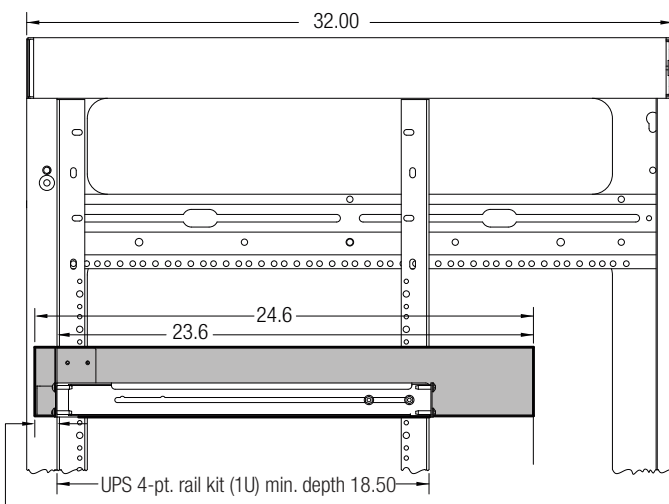

UPS bezel protrudes approx. 1" from rack rail

### Lowell Floor Rack – 32”D min.

- UPS9-3000

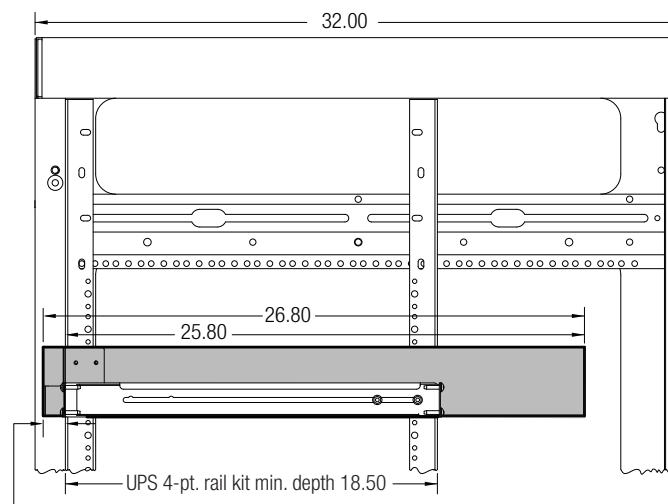

UPS bezel protrudes approx. 1" from rack rail